

Electric Meter and Transformer Testing in an AMI World





Objective

- Acceptance and Functional Testing during and after AMI
- Certification
- Accuracy Test
- Site Verification
- Instrument Testing (in shop and in field)
- Transformer Testing
- AMI meter population management

Questions to Answer

- Why do we test?
- How do we test?
- What types of meter tests are there?
- How do utility tests differ from customer request tests?
- What is In-Service Testing?
- How do we know meter tests are good?
- What do we do with the test data?
- What else should we test besides the meter?
- What range of tests/checks should be done in the shop?
- What range of tests/checks should be done in the field?
- Where is the biggest pay back for our limited meter service resources (field and shop)?

Why Do We Test?

- Our regulatory commissions require us to test meters.
- But only for accuracy. State regulatory commissions want electric utilities to ensure that no customer is being billed unfairly and that no subset of customers is being unfairly subsidized by the rest of the rate payers. Some states mandate only accuracy tests and others require demand and time of use accuracy tests.
- Any tests beyond accuracy tests are tests that are simply good business practice.



Complaint Testing

- Customers always have the right to request a meter test.
- Some utilities and some jurisdictions allow for testing at the customer site, others require a test in a laboratory environment.
- Some allow the customer to witness the test and others require the utility commission to witness the test.
- Utilities must show that the meter tests well and must demonstrate that they have a test program in place to ensure the meters in service are performing well.



General Meter Testing Requirements

- New Meters
 - Manufacturers tests
 - In-house tests on new shipments
- Return to Service Testing
- In-Service Meters
 - Periodic Tests
 - Selective, random, or statistical testing
- Retirement tests
- Testing of related metering equipment





New Meter Testing Programs

- Accept the Manufacturer's Test results
- Perform a Statistical Test of an incoming shipment
- Perform a 100% test of an incoming shipment





Return to Service Testing



- Meters to be returned to service must always (virtually every utility commission requires this) be accuracy tested before being returned to service.
- Best business practices also require that the meter is functionally tested as well.



In Service Testing


 Meter Testing for new and in-service meters is specified in ANSI C12.1-2015, American National Standard for Electric Meters, Code for Electricity Metering. Most utility commissions use this Standard a reference or the basis for their meter testing requirements.





Best Practices

- Residential vs Commercial
- Self-Contained vs Transformer Rated
- Follow the money and be as proactive as possible

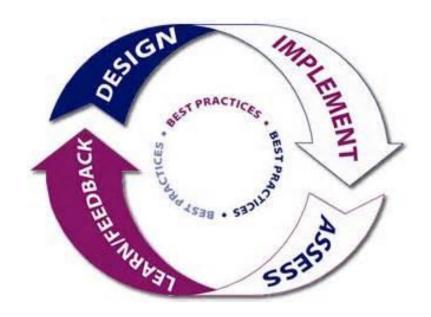

Using AMI Data

- AMI data can provide actual usage
- Site Verification data can provide a correlation to the Transformers installed at the installation
- Not a very difficult analysis to determine how often any one particular installation is operating outside of the operationg parallelogram for the installed transformers
- This allows the utility to replace these transformers with transformers that operate more accurately over a larger range of operating conditions. This is especially true as no utility can ever know who the next tenant in a building will be or how they will utilize the service or even how an existing company's needs will change over time.
- Look for missing current on a single leg or intermittent data

Self Contained

- Use AMI analytics on self-contained services to determine where there are problems
- Look for technical and non-technical losses through these analytics
- Minimize the use of field resources in checking these services
- Free up as many field and shop resources as possible to check on and be as proactive as possible with your Transformer Rated services

Why?

Because the Transformer Rated Services are where the money is!!!!

The Importance of CT Testing in the Field

- One transformer in three wired backwards will give the customer a bill of 1/3rd the actual bill.
- One broken wire to a single transformer will give the customer a bill of 2/3rd the actual bill
- One dual ratio transformer inappropriately marked in the billing system as 400:5 instead of 800:5 provides a bill that is ½ of the actual bill. And the inverse will give a bill double of what should have been sent. Both are lose-lose situations for the utility.





The Importance of CT Testing in the Field (cont)

- Cross Phasing (wiring errors)
- Loose or Corroded Connections
- CT Mounted Backwards
- CT's with Shorted Turns
- Wrong Selection of Dual Ratio CT
- Detect Magnetized CT's
- Burden Failure in Secondary Circuit
- Open or Shorted Secondary
- Mislabeled CT's
- Ensures all Shorting Blocks have been Removed



Testing at Transformer Rated Sites

- ✓ Meter Accuracy
- √ Full Load
- ✓ Light Load
- ✓ Power Factor
- √CT Health
- ✓ Burden Testing
- ✓ Ratio Testing
- ✓ Admittance Testing
- ✓ Site Verification





Poperly sizing Conventional and Extended Range CT's

- CT Ratings/Parameters
- Standard Accuracy Classes
- Extended-Range Ratings/Types
- Applying ERCTs
- Advantages of ERCT
- The historic revenue metering class is 0.3, with 0.15 being used with increasing frequency.
- 0.15 "high accuracy" classes were introduced under IEEE C57.13.6.




Fundamentals of Polyphase Field Meter Testing and Site Verification

Functionality with Burden Present on the Secondary Loop

PHASE A





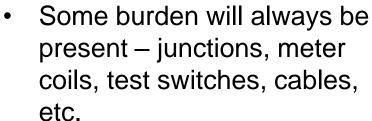

 CT's must be able to maintain an accurate ratio with burden on the secondary.






METERING ACCURACY RATING

0.3B1.8	
Accuracy Class	Burden Designation
0.15S (High Accuracy)	B0.1
0.15 (High Accuracy)	B0.2
0.3 (Metering Accuracy)	B0.5
0.6 (Indication Accuracy)	B0.9
1.2 (Indication Accuracy)	B1.8

Current Transformer Accuracy Classes

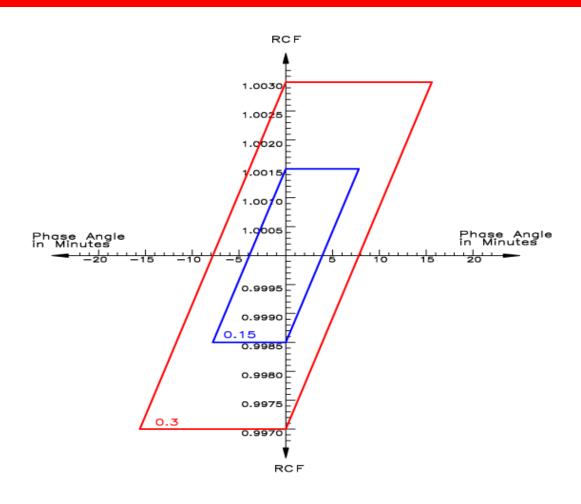


CT Error

CT error is typically negative...meaning less current in the secondary than there "should" be by the defined ratio.

CT error becomes increasingly negative as the primary current level decreases.

Negative Error = Lost Revenue


Idealized Transformer Circuit

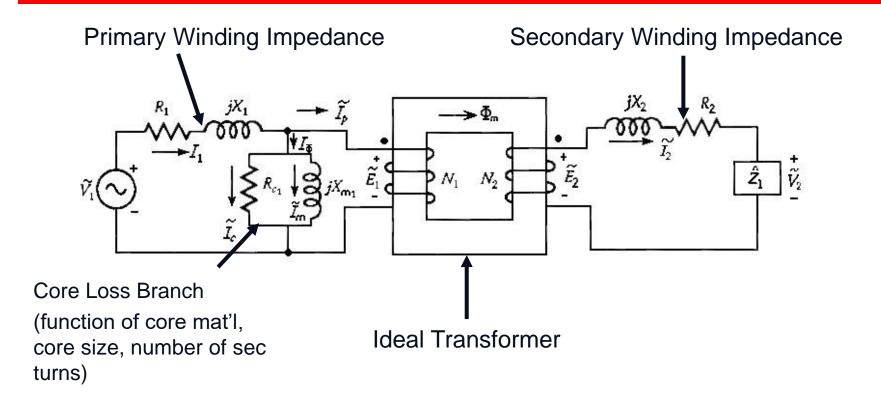


This is an illustration that the excitation current is the current lost from the primary current that does not get to the meter. Accuracy is largely a function of minimizing this excitation current and why transformer accuracy is typically negative.

Slide 22

CT 0.3 Accuracy Class

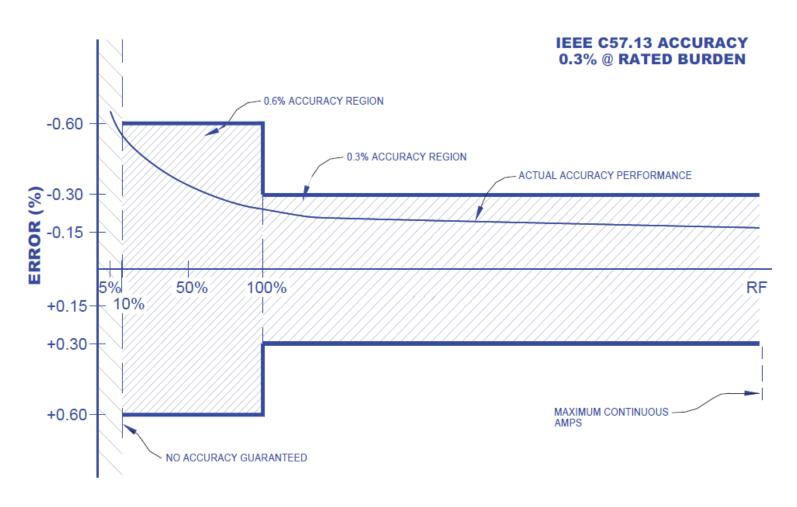

CT 0.15 Accuracy Class

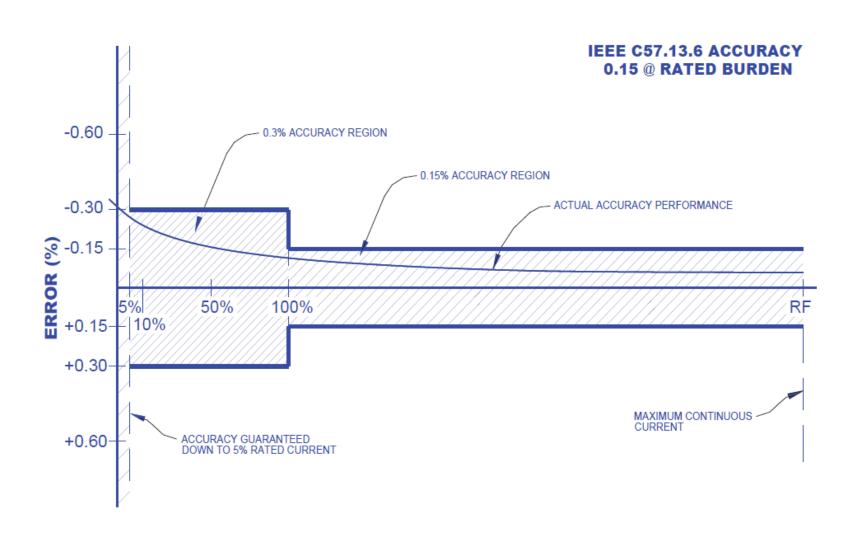

Site Verification: Potential Site Check List

- Double check the meter number, the location the test result and the meter record.
- Perform a visual safety inspection of the site. This includes utility and customer equipment.
 Things to look for include intact down ground on pole, properly attached enclosure,
 unwanted voltage on enclosure, proper trimming and site tidiness (absence of discarded
 seals, etc.).
- Visually inspect for energy diversions (intentional and not). This includes broken or missing
 wires, jumpers, open test switch, unconnected wires and foreign objects on meters or other
 metering equipment. Broken or missing wires can seriously cause the under measurement
 of energy. A simple broken wire on a CT or VT can cause the loss of 1/3 to 1/2 of the
 registration on either 3 element or 2 element metering, respectively.
- Visually check lightning arrestors and transformers for damage or leaks.
- Check for proper grounding and bonding of metering equipment. Poor grounding and bonding practices may result in inaccurate measurements that go undetected for long periods of time. Implementing a single point ground policy and practice can reduce or eliminate this type of issue.
- Burden test CTs and voltage check PTs.

Potential Site Check List (con't)

- Verify service voltage. Stuck regulator or seasonal capacitor can impact service voltage.
- Verify condition of metering control wire. This includes looking for cracks in insulation, broken wires, loose connections, etc.
- Compare the test switch wiring with the wiring at the CTs and VTs. Verify CTs and VTs not cross wired. Be sure CTs are grounded in one location (test switch) only.
- Check for bad test switch by examining voltage at the top and bottom of the switch. Also verify amps
 using amp probe on both sides of the test switch. Verify neutral connection to cabinet (voltage).
- Check rotation by closing in one phase at a time at the test switch and observing the phase meter for forward rotation. If forward rotation is not observed measurements may be significantly impacted as the phases are most likely cancelling each other out.
- Test meter for accuracy. Verify demand if applicable with observed load. If meter is performing compensation (line and/or transformer losses) the compensation should be verified either through direct testing at the site or by examining recorded pulse data.
- Loss compensation is generally a very small percentage of the overall measurement and would not be caught under utilities normal high/low checks. However, the small percentages when applied to large loads or generation can really add up overtime. Billing adjustments can easily be in the \$million range if not caught early.

Potential Site Check List (con't)

- Verify metering vectors. Traditionally this has been done using instruments such as a circuit analyzer. Many solid state meters today can provide vector diagrams along with volt/amp/pf and values using meter manufacturer software or meter displays. Many of these desired values are programmed into the meters Alternate/Utility display. Examining these values can provide much information about the metering integrity. It may also assist in determining if unbalanced loads are present and if CTs are sized properly. The vendor software generally has the ability to capture both diagnostic and vector information electronically. These electronic records should be kept in the meter shop for future comparisons.
- If metering is providing pulses/EOI pulse to customers, SCADA systems or other meters for totalization they also should be verified vs. the known load on the meter.
- Verify meter information including meter multiplier (rework it), serial number, dials/decimals, Mp, Ke, Primary Kh, Kr and Rate. Errors in this type of information can also cause a adverse impact on measured/reported values.
- Verify CT shunts are all opened.



Shop Testing

- Accuracy Testing
- Meter Communications Performance
- Software & Firmware Verification
- Setting Verification
- Functional Testing
- Disconnect/Reconnect Functionality and as left setting
- Ratio and accuracy testing
- Polarity checking
- Accuracy class determination







Shop Testing Programs

100% of all Transformers

 If not possible then sample testing of all and 100% of all those over a certain size for CT's and all VT's (generally not a large volume)

Transformer testing should include

- Ratio and accuracy testing
- Polarity checking
- Accuracy class determination

100% of all transformer rated meters

 If not possible then sample testing of all transformer rated meters and 100% of all those going into a certain size service and over

Meter testing should include

- Software & Firmware Verification
- Setting Verification
- Functional Testing
- Disconnect/Reconnect Functionality and as left setting

AMI Meter Population Management



- A Meter Farm is a representation of your meter population in the field
- The Meter Farm is designed to be a tool to measure base line performance of your meters
- Meter farms are typically located outside so meters are exposed to the same temperatures, sun and elements as your meter population.
- Meter Farms should include a simulation of the entire communication network back to the head end

AMI Meter Population Management

- A Meter Farm needs to have a statistically significant representation of your meter population in the field. This means a minimum of 30 meters regardless of population. Typical farms have 50 to 100 meters for populations up to 50,000 meters and several thousand meters for populations over two million.
- The breakdown of forms should be roughly representative of the breakdown of meters within your population. 2S meters will typically have 85 to 90% of the spots in a meter farm. Every polyphase meter is represented with a minimum of two to three sockets if possible.



Summary

- Perform a shop test of every meter going into a transformer rated service. This
 includes a functional test as well as an accuracy test.
- Perform a shop test of every CT going into a transformer rated service.
- Perform a shop test of every VT going into a transformer rated service.
- Perform a base line site verification of every transformer rated service in your service territory.
- Use your AMI analytics to determine where there are misses:
 - No draw on one leg
 - Intermittent draw on one leg
 - Performing outside the rated range for the installed transformers
 - Reversed polarity
- Start checking for field issues all over again.
- Reduce the resources spent on self-contained metering by leveraging your AMI
 data as much as possible and creating new systems and procedures to replace
 older processes that did not have the availability of this type of data.

Questions and Discussion



Tom Lawton

TESCO – The Eastern Specialty Company Knopp, Inc. – A TESCO Company Bristol, PA and Emeryville, CA

> 215-688-0298 (cell) 215-785-2338 (office)

This presentation can also be found on the TESCO web site:

www.tescometering.com