



THE EASTERN SPECIALTY COMPANY

FUNDAMENTALS OF TRANSFORMER-RATED FIELD METER TESTING AND SITE VERIFICATION



Prepared by Rob Reese, TESCO
The Eastern Specialty Company



THE EASTERN SPECIALTY COMPANY

WHAT IS SITE VERIFICATION?

- Why is Site Verification Important?
 - More than Meter Testing
 - Testing and Inspecting the Entire Service
- Overview of Transformer-Rated Meter Installations
- Transformer-Rated Meter Installation Verifications
 - What to Inspect and Test
- Detailed Testing Theory and Equipment
 - Meter Accuracy
 - CT Burden, Ratio, Admittance
 - Vectors and Harmonics
 - Hot Socket




THE EASTERN SPECIALTY COMPANY

WHAT IS SITE VERIFICATION?

Testing and inspection of more than just the meter accuracy.



99.975% Registration

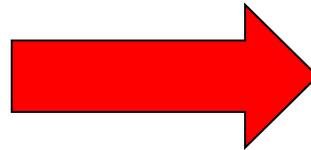



THE EASTERN SPECIALTY COMPANY

PREMISE

- Over much of the 20th century, utilities, regulators and customers each relied upon lab and field meter testing efforts which were primarily focused upon the accuracy of the watt-hour meter and demand register.
- This focus is now changing with the deployment of electronic AMR and AMI meters to the majority of the 155 Million connected customers in North America.
- The focus has now shifted from just the accuracy of the meter to also checking other features of the meter (e.g. communication and disconnect devices), the firmware versions and settings of the meter, and the overall meter installations for both residential and C&I customers.
- Incorrect or miscalculated site information or undetected problems can lead to an improperly metered customer not related to the meters accuracy and could also lead to potential safety issues.



THE EASTERN SPECIALTY COMPANY

Common Features and Common Sources of Concern

Electro Mechanical meters were subject to registration errors caused by mechanical issues with moving parts resulting in either the loss of revenue to the utility or over billing for the customer. Some of the more common problems were:

- Friction wear
- Gear mesh misalignment
- Retarding magnet failure
- Timing motors





THE EASTERN SPECIALTY COMPANY

ELECTRONIC METERS – NEW FAILURE MODES REQUIRE NEW TESTING AND INSPECTION METHODS

Electronic meters fail as do electromechanical meters but differently

Their overall life expectancy is not nearly the same

Failure modes include drift (unexpected)

Failure modes include catastrophic (expected)

Power supply damage due to lightning surges or other causes

LCD Display failures making a visual read impossible when required

- AMR/AMI communications module failures requiring a field visit to repair or replace meter/AMI module and get a read for billing purposes
- Failure modes include non-catastrophic but significant measurement error modes sometimes attributed to improper meter programming and in some cases meter firmware issues.
- Failure modes can include non-measurement issues which render the meter ineffective or inaccurate for billing purposes
- Clerical errors such as incorrect multipliers can do more damage than even the most catastrophic equipment failure in the field.






THE EASTERN SPECIALTY COMPANY

BEST PRACTICES

- Residential vs Commercial
- Self-Contained vs Transformer Rated
- Follow the money and be as proactive as possible

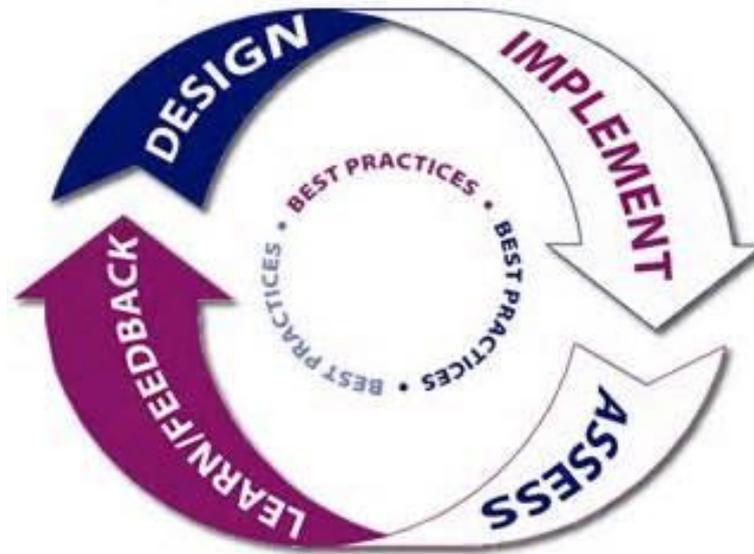



THE EASTERN SPECIALTY COMPANY

WHY SITE VERIFICATIONS ARE A VALUABLE UTILITY TOOL

- It is important to remember that with current systems it is not just the meter that can cause a major error in the measurement of a given service
- A meter test that indicates a meter is within the required accuracy parameters does not mean your service is being measured and billed accurately
- A meter test may not catch intermittent errors or identify errors with other equipment at the site, e.g. CT's & PT's
- A discrepancy between what is thought to be at a given site and what is actually at that site can cause a major billing error (either over or under billed)





THE EASTERN SPECIALTY COMPANY

WHY C&I AND WHAT SHOULD WE INVEST OUR LIMITED METER SERVICE RESOURCES HERE?

- Easy Answer: Money.
- These customers represent a disproportionately large amount of the overall revenue for every utility in North America.
- For some utilities the ten percent of their customers who have transformer rated metering services can represent over 70% of their overall revenue.
- While these numbers will vary from utility to utility the basic premise should be the same for all utilities regarding where Meter Services should focus their efforts – follow the money.





THE EASTERN SPECIALTY COMPANY

WHAT ARE OUR INDUSTRY'S "BEST PRACTICES" FOR THIS TYPE OF WORK?

- Most Utilities do not have a comprehensive and complete list of every instrument transformer on their system that is involved in providing the billing for the largest 10 to 20% of any utilities revenue.
- Most Utilities do not visit, document and verify these same services on any regular basis.
- Best practices call for the on-site verification of a Utilities "largest" customers on a periodic basis.
 - There is no definition of what this verification should entail
 - There is no definition of what "largest" means
 - There is no agreement on the frequency of this "periodic" inspection





THE EASTERN SPECIALTY COMPANY

DEFINE "LARGEST" AND WHAT THIS MAY REPRESENT

- Largest should be defined by revenue.
- Lost metering revenue is no longer "recovered in the next rate case", nor is recovered metering revenue necessarily "given back" in the next rate case.
- Utility Commissions are having less tolerance for new rate cases.
- Over billing of any customer has always been a public relations nightmare.
- A facility with an electric bill of \$10,000 per month would pay for a meter tech in two years if an error affecting the wiring of only one transformer (estimated lost revenue \$160,000 over a two year period). Does this mean that \$10,000 per month or more defines large?





THE EASTERN SPECIALTY COMPANY

DEFINE “LARGEST” AND WHAT THIS MAY REPRESENT

- Largest should be defined by revenue.
- Lost metering revenue is no longer “recovered in the next rate case”, nor is recovered metering revenue necessarily “given back” in the next rate case.
- Utility Commissions are having less tolerance for new rate cases.
- Over billing of any customer has always been a public relations nightmare.
- A facility with an electric bill of \$10,000 per month would pay for a meter tech in two years if an error affecting the wiring of only one transformer (estimated lost revenue \$160,000 over a two year period). Does this mean that \$10,000 per month or more defines large?
 - I would argue that this size customer is universally a “Large customer” and that from here each utility should decide how much smaller they should go in their definition of “Large”.





THE EASTERN SPECIALTY COMPANY

DEFINE “PERIODICALLY” AND HOW FREQUENT THIS MAY BE

- If changes in usage, equipment failures in the metering service, external damage to the service, or energy diversion at a single “large” customer can pay for a single meter tech in just two or three years, and a single meter tech can handle several of these inspections in a single day, then there is ample cost justification for inspecting these services at least once every year.





THE EASTERN SPECIALTY COMPANY

SELF-CONTAINED VS. TRANSFORMER-RATED

Self Contained
(direct)

Transformer-Rated
(indirect)





THE EASTERN SPECIALTY COMPANY

SELF-CONTAINED METERING

Primarily Residential
(1S, 2S, 12S)

Relatively Low Current
Example: 100A

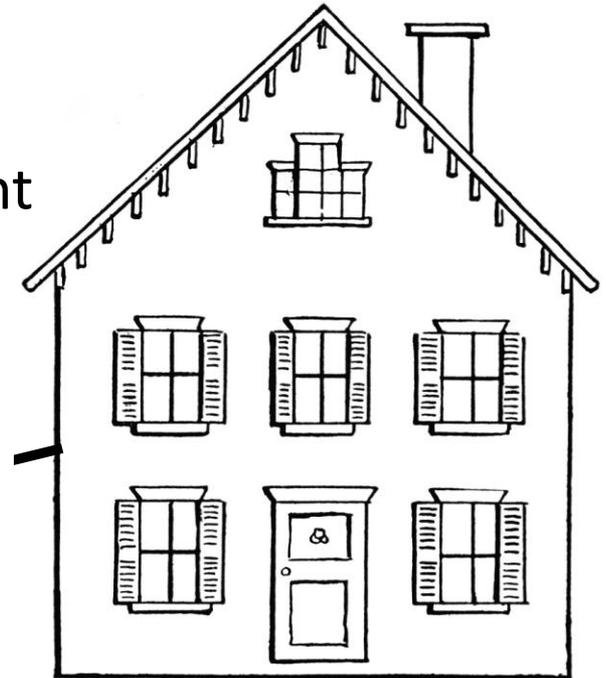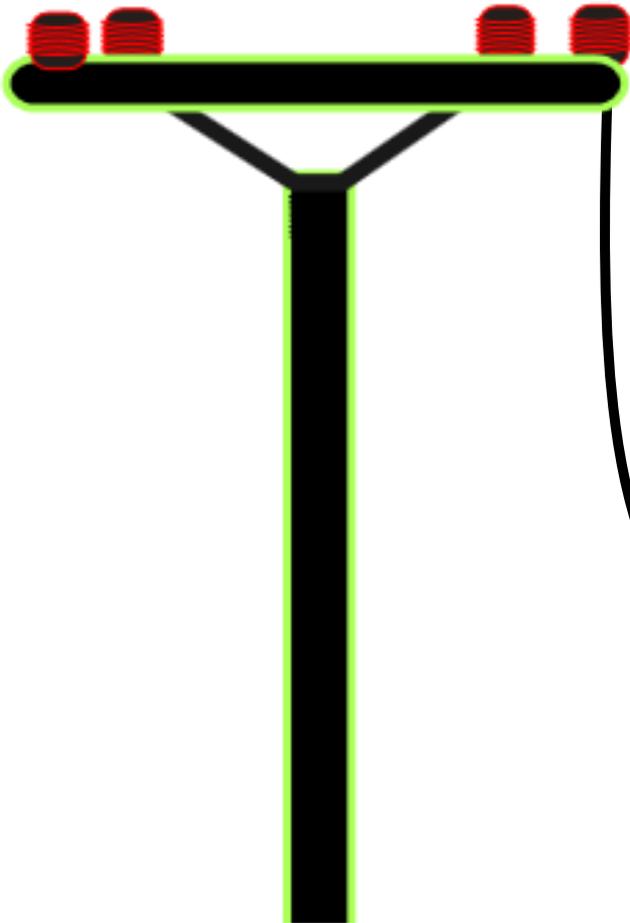




THE EASTERN SPECIALTY COMPANY

SELF-CONTAINED METERING

Primarily Residential (1S, 2S, 12S)

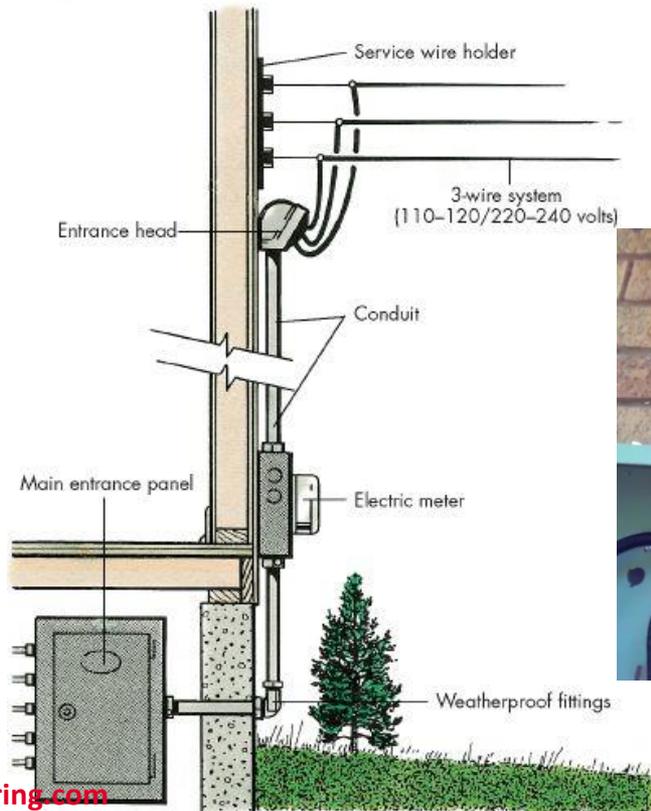




THE EASTERN SPECIALTY COMPANY

TRANSFORMER-RATED METERING

Primarily Commercial/Industrial
(9S, 16S)

Relatively High Current
Example: 400A

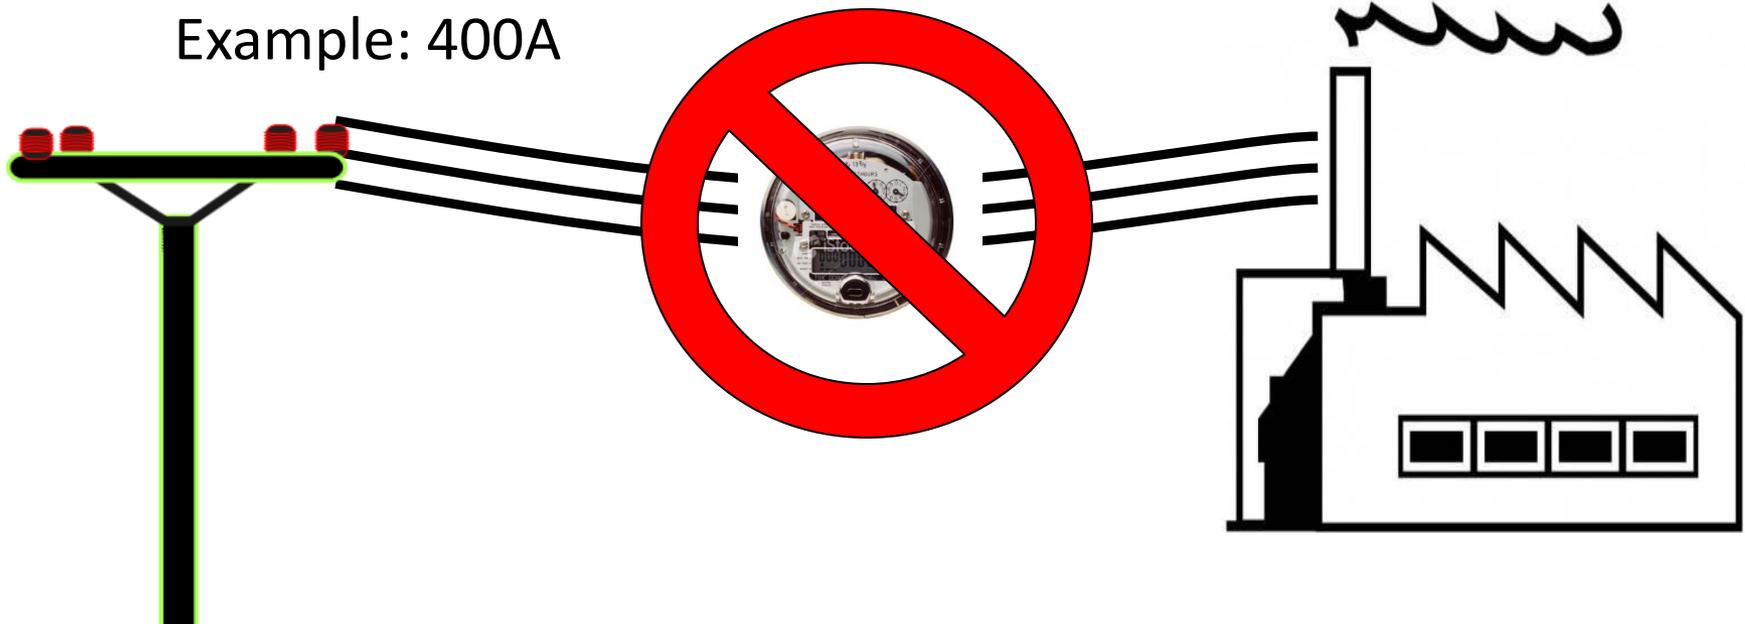




THE EASTERN SPECIALTY COMPANY

TRANSFORMER-RATED METERING

Primarily Commercial/Industrial (9S, 16S)


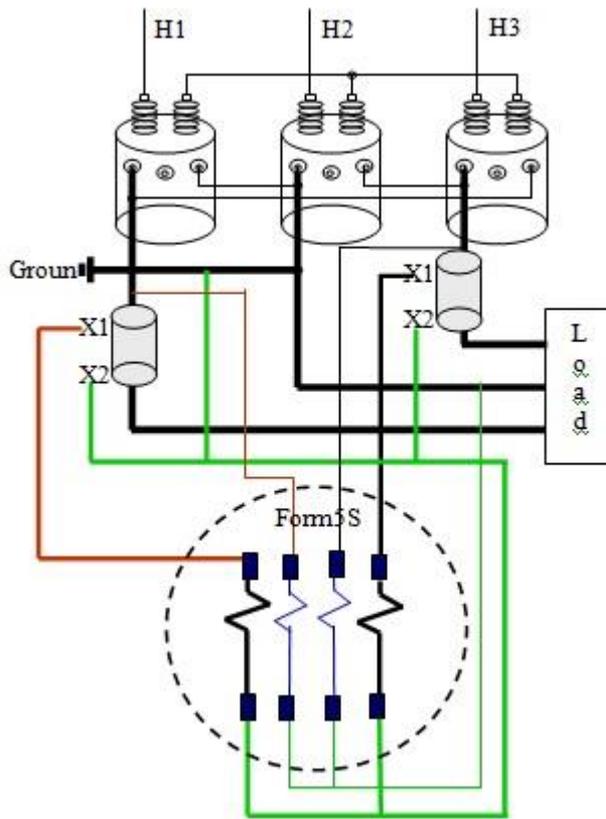




THE EASTERN SPECIALTY COMPANY

TRANSFORMER-RATED METERING

Typical Components of an Installation

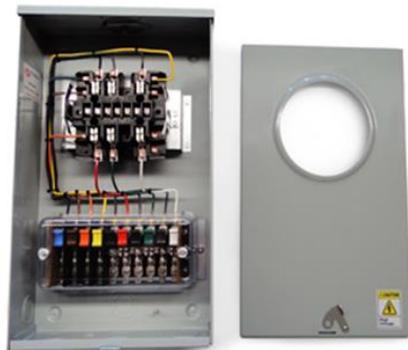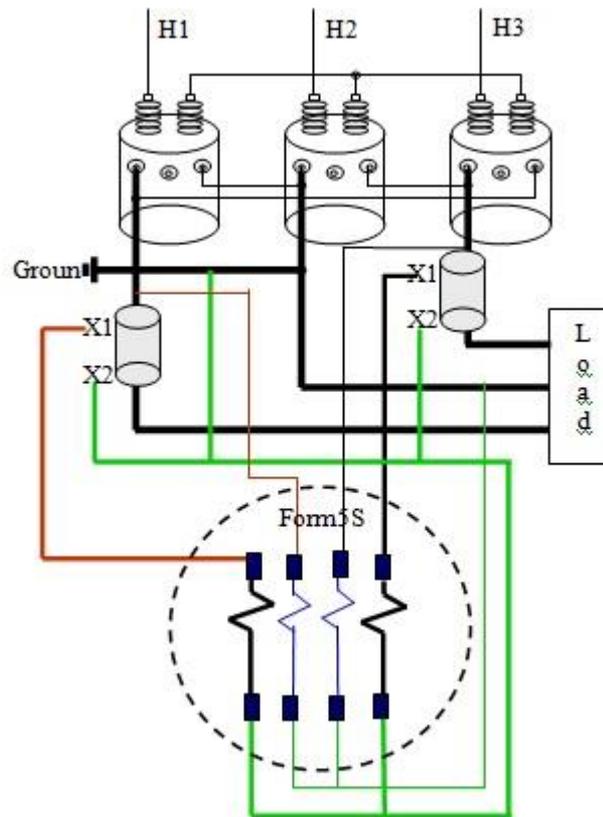



THE EASTERN SPECIALTY COMPANY

TRANSFORMER-RATED METERING VERIFICATION



Potential list of tasks to be completed:

Double check the meter number, the location the test result and the meter record

Perform a visual safety inspection of the site. This includes utility and customer equipment. Things to look for include intact down ground on pole, properly attached enclosure, unwanted voltage on enclosure, proper trimming and site tidiness (absence of discarded seals, etc.)

Visually inspect for energy diversions (intentional and not). This includes broken or missing wires, jumpers, open test switch, unconnected wires and foreign objects on meters or other metering equipment. Broken or missing wires can seriously cause the under measurement of energy. A simple broken wire on a CT or VT can cause the loss of 1/3 to 1/2 of the registration on either 3 element or 2 element metering, respectively.

Visually check lightning arrestors and transformers for damage or leaks.

Check for proper grounding and bonding of metering equipment. Poor grounding and bonding practices may result in inaccurate measurements that go undetected for long periods of time. Implementing a single point ground policy and practice can reduce or eliminate this type of issue.

Burden, Ratio, and/or Admittance test CTs and voltage check PTs.





THE EASTERN SPECIALTY COMPANY

TRANSFORMER-RATED METERING VERIFICATION



Burden, Ratio, and/or Admittance test CTs and voltage check PTs.

Verify service voltage. Stuck regulator or seasonal capacitor can impact service voltage.

Verify condition of metering control wire. This includes looking for cracks in insulation, broken wires, loose connections, etc.

Compare the test switch wiring with the wiring at the CTs and VTs. Verify CTs and VTs not cross wired. Be sure CTs are grounded in one location (test switch) only.

Check for bad test switch by examining voltage at the top and bottom of the switch. Also verify amps using amp probe on both sides of the test switch. Verify neutral connection to cabinet (voltage).



Check rotation by closing in one phase at a time at the test switch and observing the phase meter for forward rotation. If forward rotation is not observed measurements may be significantly impacted as the phases are most likely cancelling each other out.

Test meter for accuracy. Verify demand if applicable with observed load. If meter is performing compensation (line and/or transformer losses) the compensation should be verified either through direct testing at the site or by examining recorded pulse data.



THE EASTERN SPECIALTY COMPANY

TRANSFORMER-RATED METERING VERIFICATION



Verify metering vectors. Traditionally this has been done using instruments such as a circuit analyzer. Many solid state meters today can provide vector diagrams along with volt/amp/pf and values using meter manufacturer software or meter displays. Many of these desired values are programmed into the meters Alternate/Utility display. Examining these values can provide much information about the metering integrity. It may also assist in determining if unbalanced loads are present and if CTs are sized properly. The vendor software generally has the ability to capture both diagnostic and vector information electronically. These electronic records should be kept in the meter shop for future comparisons.

If metering is providing pulses/EOI pulse to customers, SCADA systems or other meters for totalization they also should be verified vs. the known load on the meter. If present test/inspect isolation relays/pulse splitters for things like blown fuses to ensure they are operating properly.



Verify meter information including meter multiplier (rework it), serial number, dials/decimals, Mp, Ke, Primary Kh, Kr and Rate. Errors in this type of information can also cause a adverse impact on measured/reported values.



THE EASTERN SPECIALTY COMPANY

TRANSFORMER-RATED METERING VERIFICATION




Verify CT shunts are all opened.

Look for signs of excessive heat on the meter base e.g.
melted plastic or discoloration related to heat



TESTING THEORY AND EQUIPMENT

Most Important Tools You Have!

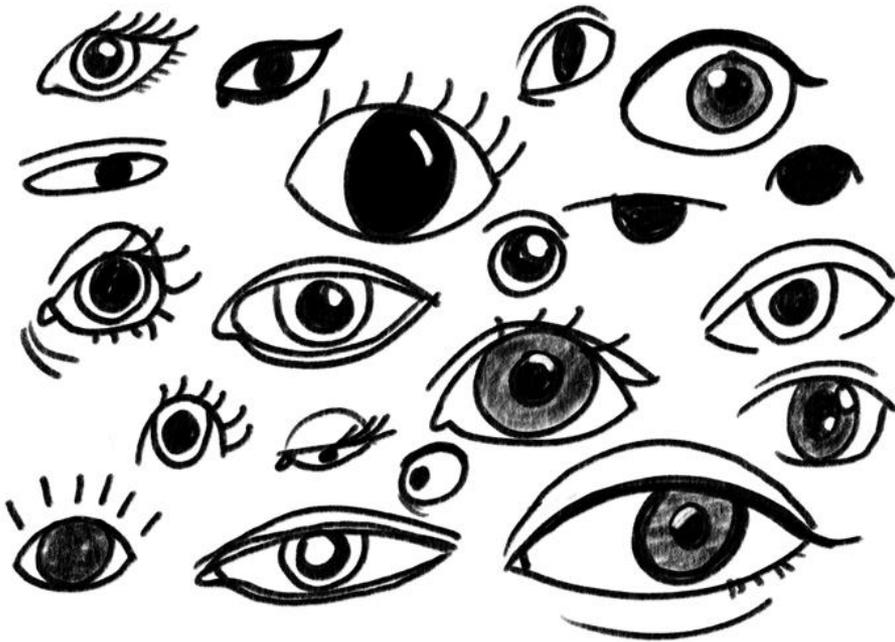





THE EASTERN SPECIALTY COMPANY

TESTING THEORY AND EQUIPMENT


Meter Accuracy Testing – A Comparison Test

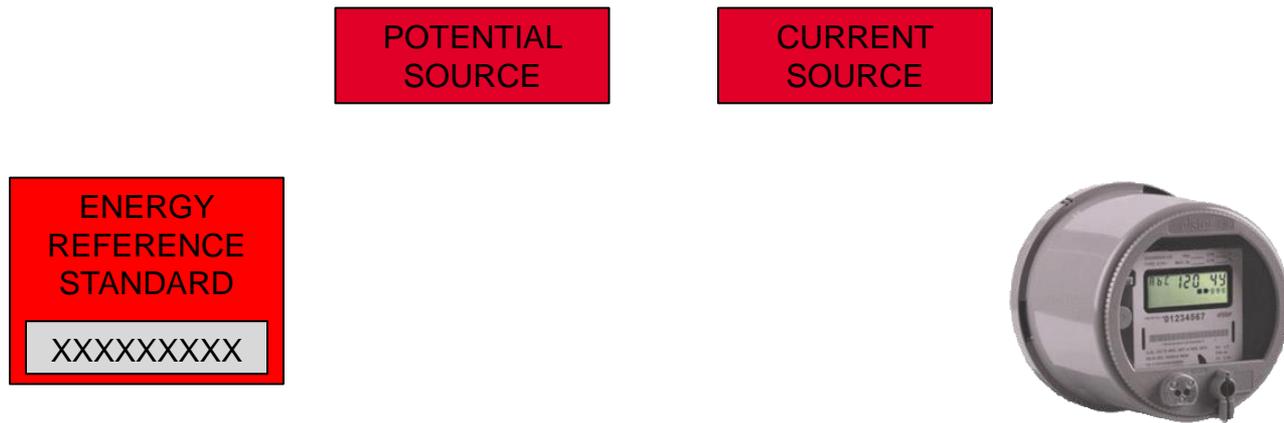


Meter Accuracy Testing – A Comparison Test

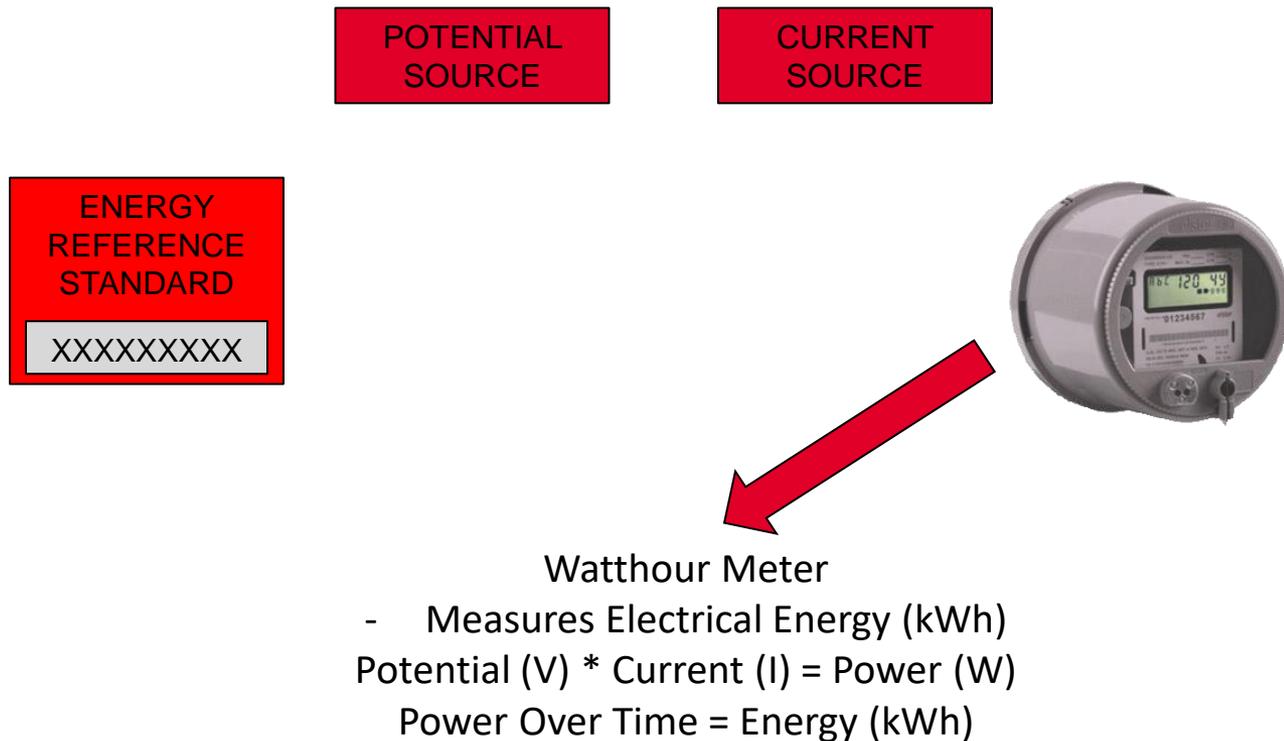

Meter Accuracy Testing – A Comparison Test

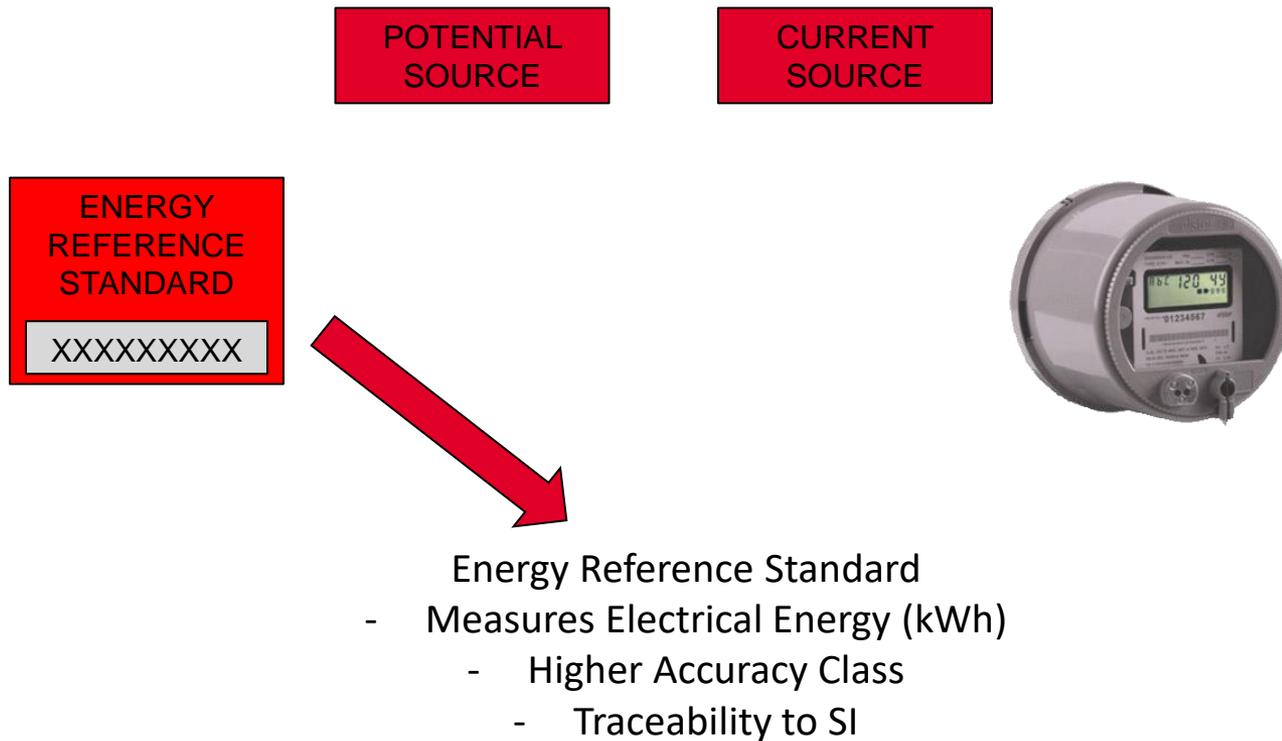


Meter Accuracy Testing – A Comparison Test

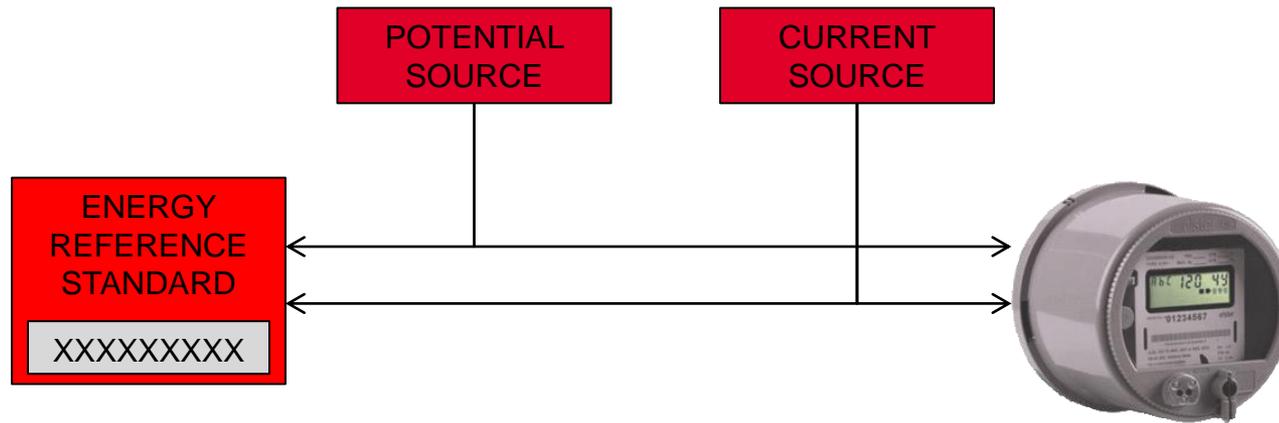

- Apply the Same Voltage and Current to the Standard and Meter for a Defined Period of Time
 - Standard and Meter Should Measure the Same Energy
 - The Difference is the Error of the Meter

Meter Accuracy Testing – A Comparison Test

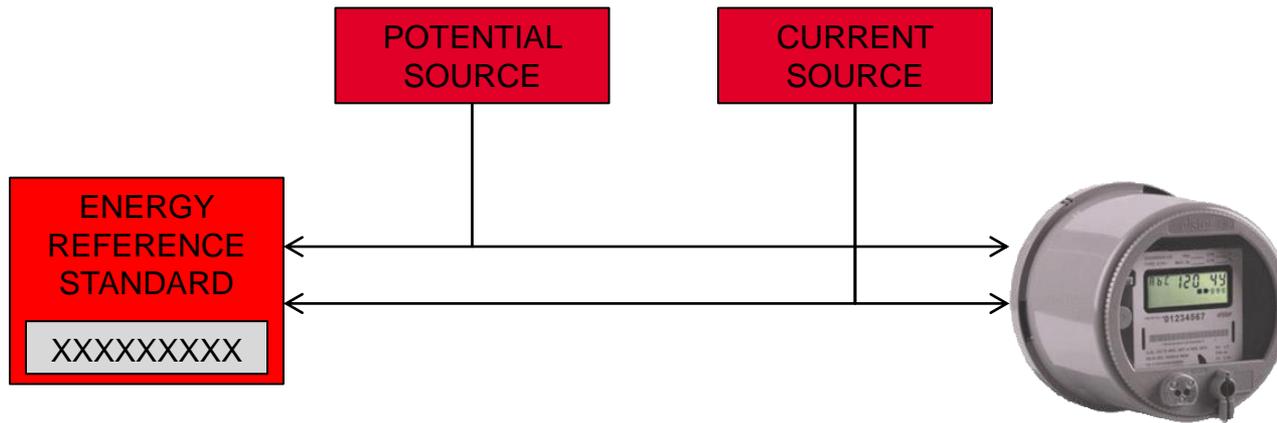

Example:

Standard Registers 100kWh / Meter Registers 101.38

Then the Error of the Meter is 1.38%



THE EASTERN SPECIALTY COMPANY

Ratio, Burden, and Admittance



ALSTOM
OUTDOOR CURRENT TRANSFORMER 15 kV


TYPE: OIL FILLED	SECONDARY CONNECTION	RATIO
HZ = 60	X1 - X3	300 : 5A
BIL: 550 kV	X2 - X3	150 : 5A
PRIMARY: 150/300 AMPS		
SECONDARY: 5 AMPS		
RATIO: 30/60 : 1		
RATING FACTOR: 1.5		
ACCURACY: 0.3% B0.1 TO B1.8		
SERIAL NO. 1FD-0256	MFG. DATE: 4/00	
CATALOG NO.: CTH3-15-0300		
CUSTOMER P.O. # P000579-00	F.O. # F3657	

300 WEST ANTELOPE ROAD, MEDFORD OREGON 97503-1089 USA



THE EASTERN SPECIALTY COMPANY

EXAMPLE APPLICATION

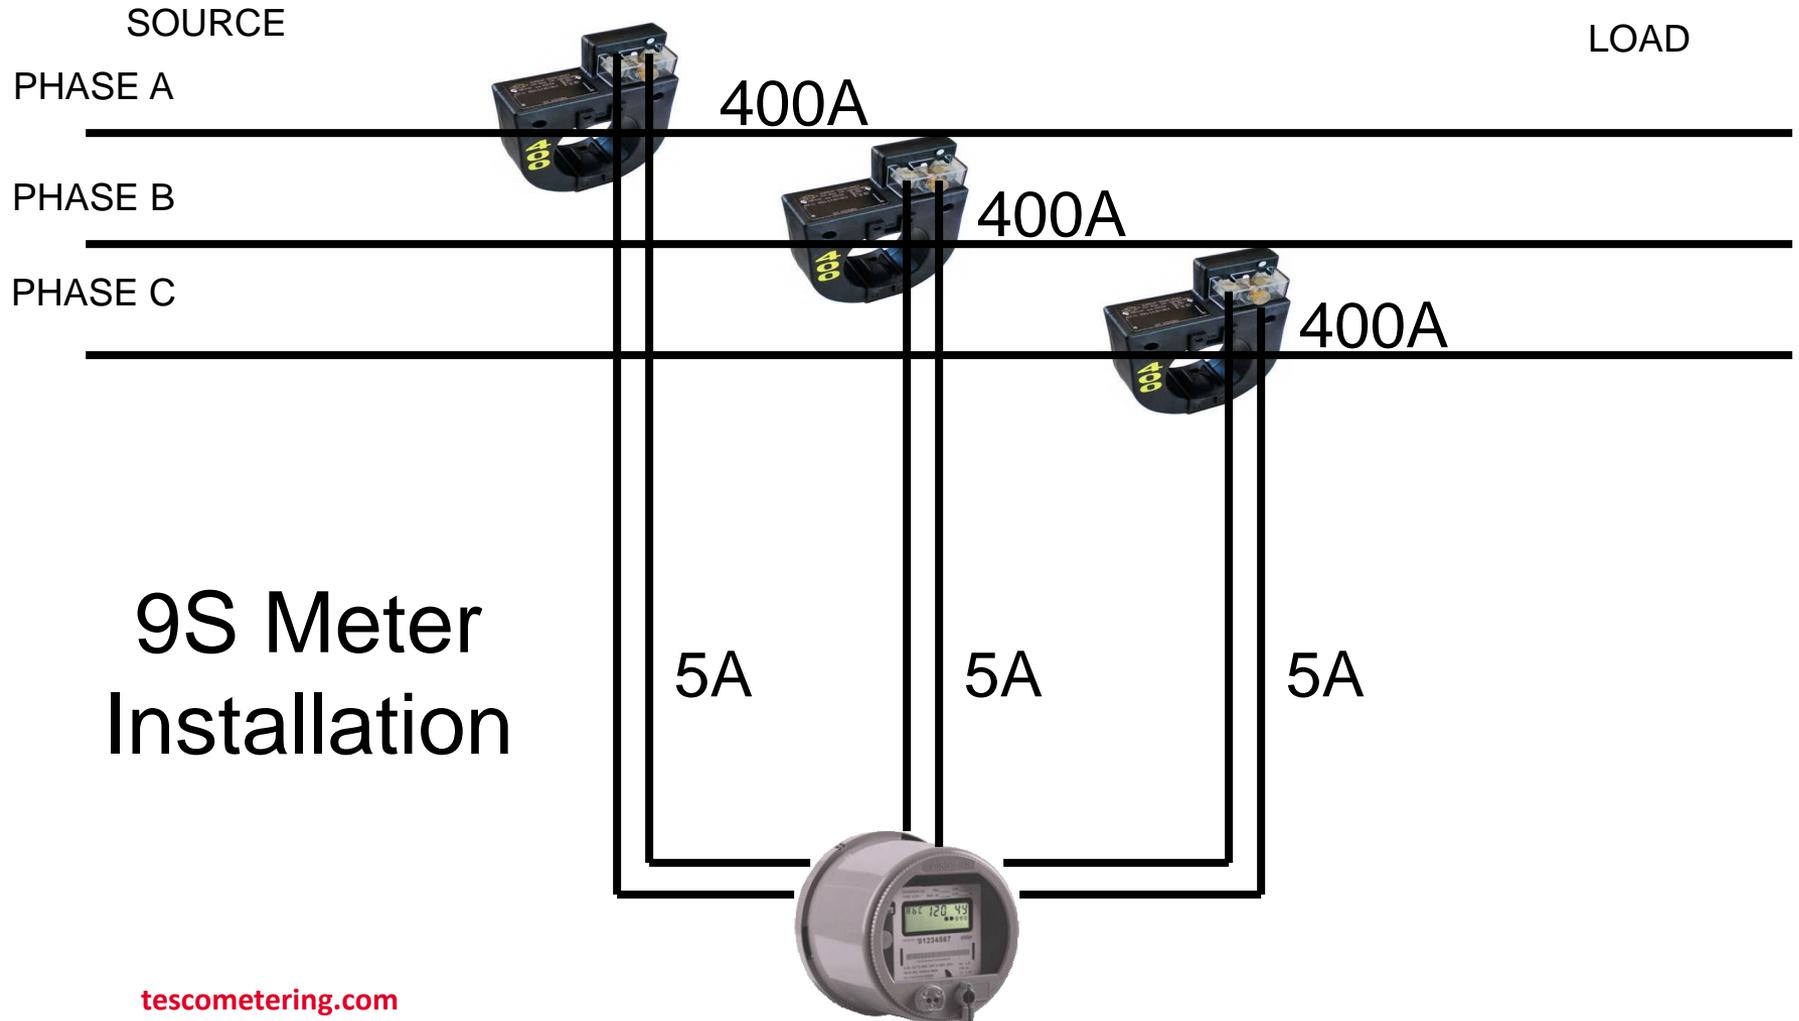



THE EASTERN SPECIALTY COMPANY

FACEPLATE SPECIFICATIONS

ALSTOM

OUTDOOR CURRENT TRANSFORMER **115** kV

TYPE: OIL FILLED	SECONDARY CONNECTION	RATIO
HZ = 60	X1 - X3	300 : 5A
BIL: 550 kV	X2 - X3	150 : 5A
PRIMARY: 150/300 AMPS		
SECONDARY: 5 AMPS		
RATIO: 30/60 :1		
RATING FACTOR: 1.5		
ACCURACY: 0.3% B0.1 TO B1.8		
SERIAL NO. IFD-0256 MFG. DATE: 4/00		
CATALOG NO.: CTH3-115-0300		
CUSTOMER P.O. # F000579-00		F.O. # F3657

300 WEST ANTELOPE ROAD, MEDFORD OREGON 97503-1089 USA



THE EASTERN SPECIALTY COMPANY

FACEPLATE SPECIFICATIONS

ALSTOM

OUTDOOR CURRENT TRANSFORMER **15** kV

TYPE: OIL FILLED	SECONDARY CONNECTION	RATIO
HZ = 60	X1 - X3	300 : 5A
BIL: 550 kV	X2 - X3	150 : 5A
PRIMARY: 150/300 AMPS		
SECONDARY: 5 AMPS		
RATIO: 30/60 :1		
RATING FACTOR: 1.5		
ACCURACY: 0.3% B0.1 TO B1.8		
SERIAL NO. IFD-0256 MFG. DATE: 4/00		
CATALOG NO.: CTH3-115-0300		
CUSTOMER P.O. # F000579-00		F.O. # F3657

300 WEST ANTELOPE ROAD, MEDFORD OREGON 97503-1089 USA

Ratio



THE EASTERN SPECIALTY COMPANY

CTs RATIO



For instance, a CT with a 400:5 ratio will produce 5A on the secondary, when 400A are applied to the primary.



THE EASTERN SPECIALTY COMPANY

FACEPLATE SPECIFICATIONS

Burden
Rating

ALSTOM

OUTDOOR CURRENT TRANSFORMER **15** kV

TYPE: OIL FILLED	SECONDARY CONNECTION	RATIO
HZ = 60	X1 - X3	300 : 5A
BIL: 550 kV	X2 - X3	150 : 5A
PRIMARY: 150/300 AMPS		
SECONDARY: 5 AMPS		
RATIO: 30/60 :1		
RATING FACTOR: 1.5		
ACCURACY: 0.3% B0.1 TO B1.8		
SERIAL NO. IFD-0256 MFG. DATE: 4/00		
CATALOG NO.: CTH3-115-0300		
CUSTOMER P.O. # F000579-00		F.O. # F3657

300 WEST ANTELOPE ROAD, MEDFORD OREGON 97503-1089 USA



THE EASTERN SPECIALTY COMPANY

BURDEN RATING


The burden range, present in the secondary circuit, that the manufacturer will guarantee their CT's will still accurately function, in regards to the ratio specification.

Ratio of Primary Current to Secondary Current

SOURCE

LOAD

PHASE A

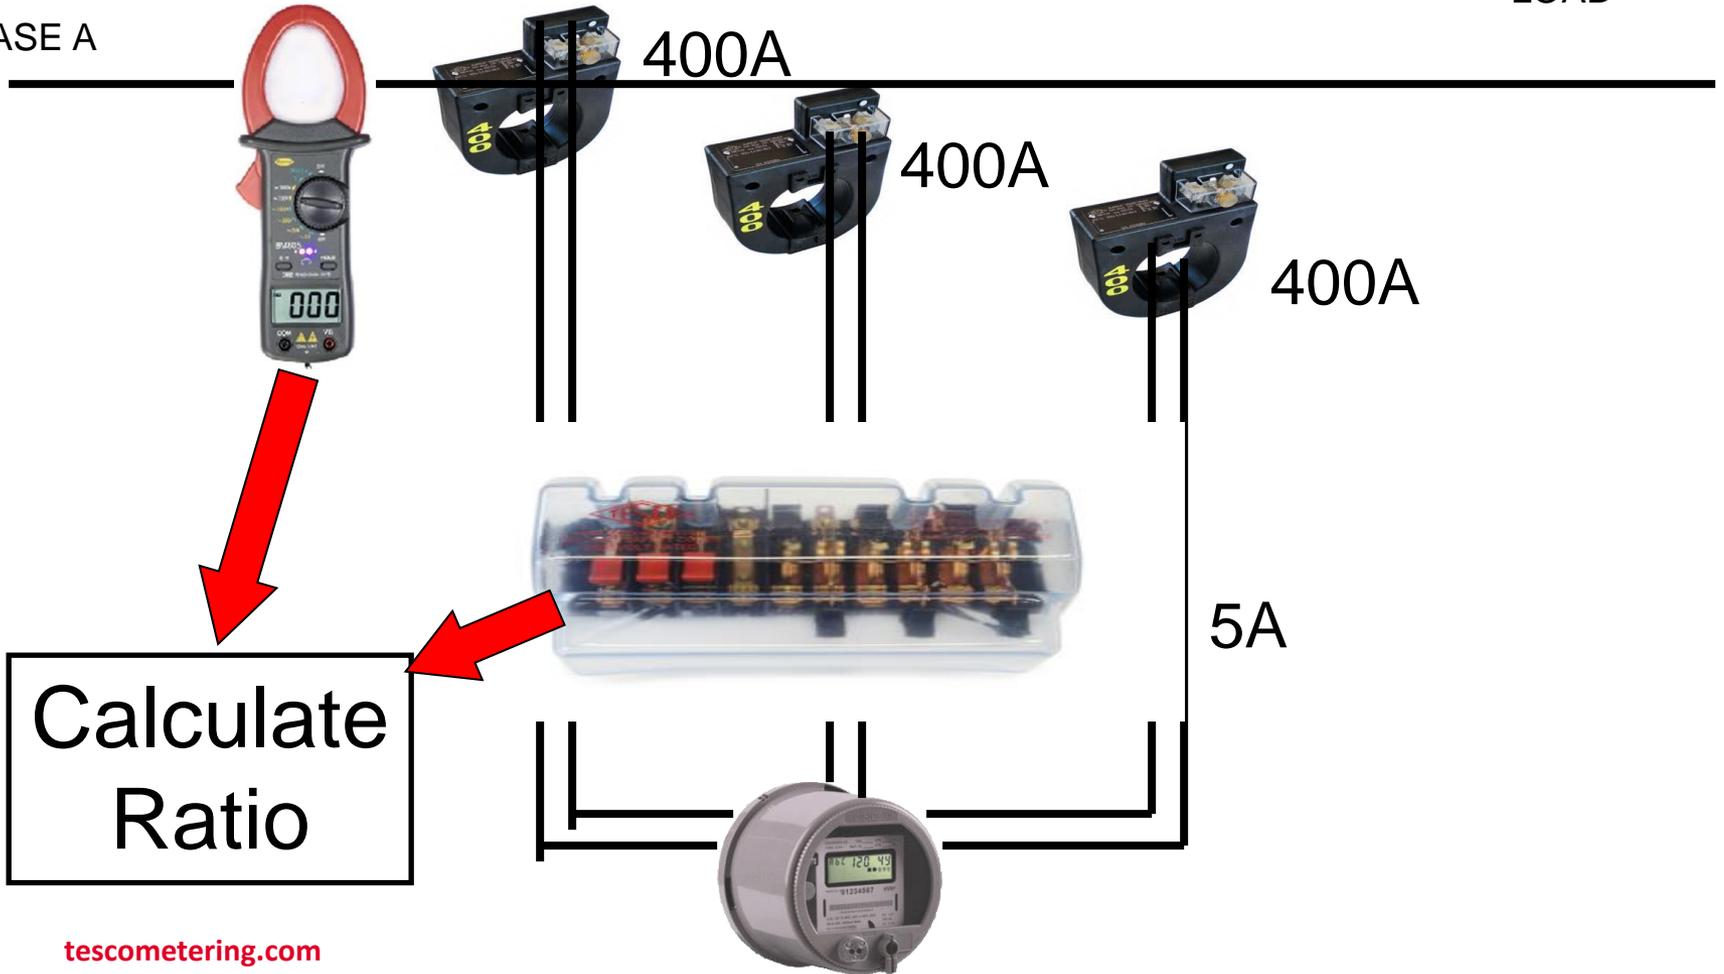




THE EASTERN SPECIALTY COMPANY

BURDEN TESTING

Functionality with Burden Present on the Secondary Loop

PHASE A

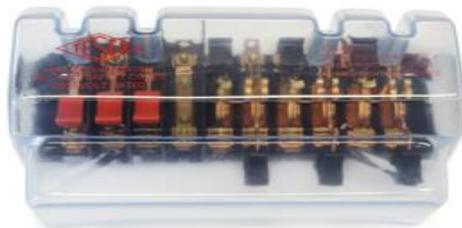


Some burden will always be present – junctions, meter coils, test switches, cables, etc.

CT's must be able to maintain an accurate ratio with burden on the secondary.

Functionality with Burden Present on the Secondary Loop

PHASE A

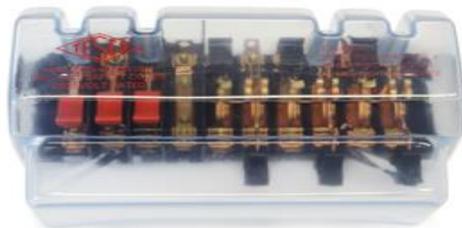

Some burden will always be present – junctions, meter coils, test switches, cables, etc.

CT's must be able to maintain an accurate ratio with burden on the secondary.




Functionality with Burden Present on the Secondary Loop

Example Burden Spec:
0.3% @ B0.1, B0.2, B0.5

or

There should be less than the 0.3% change in secondary current from initial ("0" burden) reading, when up to 0.5Ohms of burden is applied

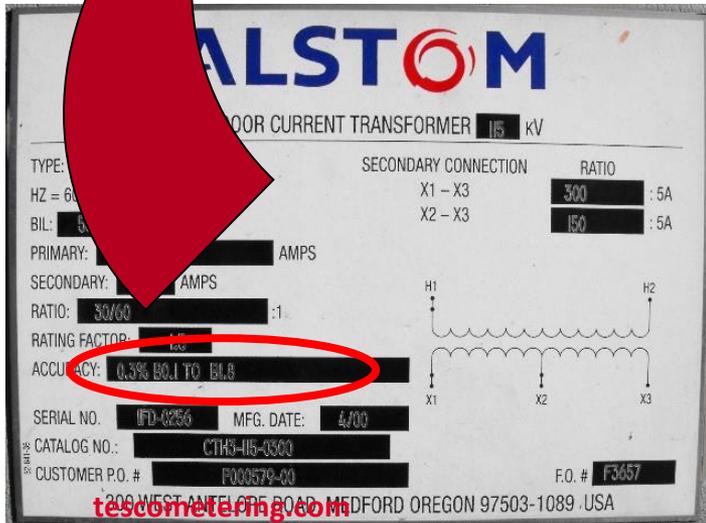



THE EASTERN SPECIALTY COMPANY

BURDEN TESTING

Functionality with Burden Present on the Secondary Loop



ANSI Burden Values

- 0.1 Ohms
- 0.2 Ohms
- 0.5 Ohms
- 1 Ohms
- 2 Ohms
- 4 Ohms
- 8 Ohms






THE EASTERN SPECIALTY COMPANY


BURDEN TESTING

Functionality with Burden Present on the Secondary Loop

PHASE A



shutterstock.com • 1519445756

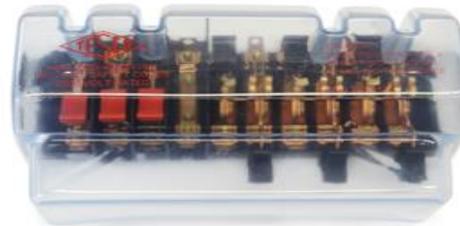



THE EASTERN SPECIALTY COMPANY


BURDEN TESTING

0.3% @ B0.1, B0.2, B0.5

Initial Reading = 5Amps

$0.3\% \times 5A = 0.015A$

$5A - 0.015 = 4.985A$

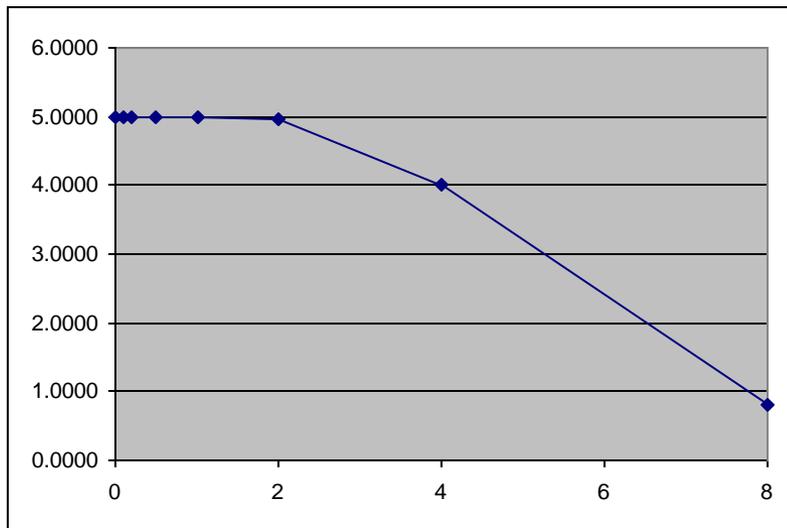


Burden	Reading
0	5.0000
0.1	4.9999
0.2	4.9950
0.5	4.9900
1	4.9800
2	4.9500
4	4.0000
8	0.8000

0.3% @ B0.1, B0.2, B0.5

Initial Reading = 5Amps

$$0.3\% \times 5A = 0.015A$$

$$5A - 0.015 = 4.985A$$

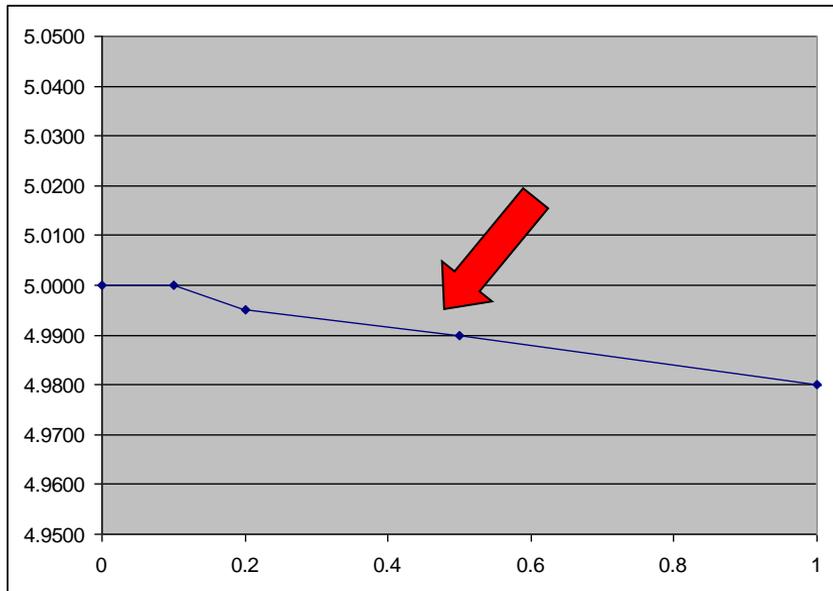

At 0.5Ohms of Burden
the secondary current is still at
4.990A – Less than 0.3% change –
Good CT!

Burden	Reading
0	5.0000
0.1	4.9999
0.2	4.9950
0.5	4.9900
1	4.9800
2	4.9500
4	4.0000
8	0.8000



THE EASTERN SPECIALTY COMPANY

ADMITTANCE TESTING

- What is Admittance?
- Admittance testing measures the overall “health” of the secondary loop of the CT.
- Measured in units of MiliSiemens (mS)
- Admittance is the inverse of impedance.
- Impedance is the opposition to current.
- Therefore, admittance testing measures the overall “health” of the secondary loop of the CT.





ADMITTANCE TESTING

- Admittance testing devices inject an audio sine wave signal into the secondary loop of the CT.
- The resulting current is measured.
- The voltage of the initial signal is known.
- From these two parameters, the impedance, and thus the admittance can be calculated.



THE EASTERN SPECIALTY COMPANY

ADMITTANCE TESTING

- Admittance test results are not immediately intuitive.
- Some analysis and interpretation is need.
- What do all these mS values mean?



THE EASTERN SPECIALTY COMPANY

ADMITTANCE TESTING

Three phase process is recommended.

1. Test each CT individually
2. Test the matched sets
3. Test over time



THE EASTERN SPECIALTY COMPANY

HOT SOCKET CHECKS





THE EASTERN SPECIALTY COMPANY

REFERENCES AND CITATIONS

1. <http://www.texasmeter.com/>
2. <https://home.howstuffworks.com/home-improvement/repair/how-to-do-home-electrical-repairs.htm>
3. <https://www.youtube.com/watch?v=SeyojxVonrk>
4. <https://www.tescometering.com/product/tesco-transockets/>
5. <http://www.gecdurham.com/>
6. <https://www.radianresearch.com/>
7. <http://www.brooksutility.com/products/122>



THE EASTERN SPECIALTY COMPANY

QUESTIONS AND DISCUSSION

Rob Reese

TESCO – The Eastern Specialty Company

Bristol, PA

215.310.8809 (cell)

This presentation can also be found under Meter
Conferences and Schools on the TESCO website:
tescometering.com

